
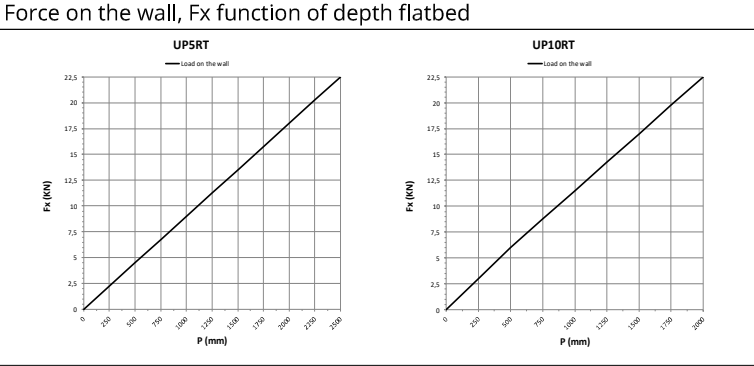


Motor	Tension-functioning	Starter	Suggested switch*	Rated current	Current starter
3kW	220 V - 3ph	Direct	3x16A id=0,3A	10	35
	380 V - 3ph	Direct	4x16A id=0,3A	5	22
4kW	220 V - 3ph	Direct	3x20A id=0,3A	16	50
	380 V - 3ph	Direct	4x16A id=0,3A	8	25
5,5kW	220 V - 3ph	Direct	4x25A id=0,3A	22	60
	380 V - 3ph	Direct	4x16A id=0,3A	11	35

MODEL: UP5RT - 500Kg UP10RT - 1000Kg

Date: _____ Signature for approval: _____

MISURE IN mm





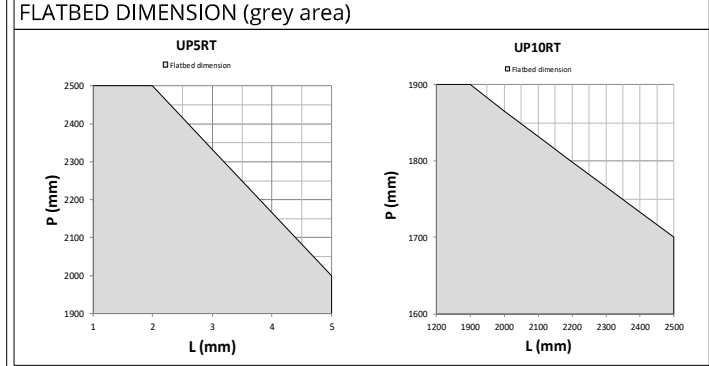


directlifts 1300 240 298 | info@directlifts.com.au | www.directlifts.com.au


Q.TA DESCRIZIONE: MODEL: UP5-10RT

STROKE MAX: 12000mm
ONLY FOR GOODS

Clijente: _____
Data: 09/09/19
Disegno n.: TAV-UP5-10RT-STD01

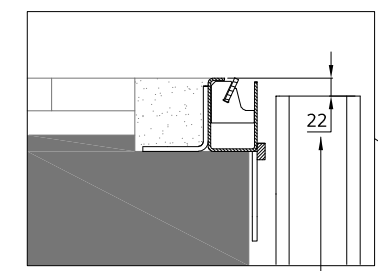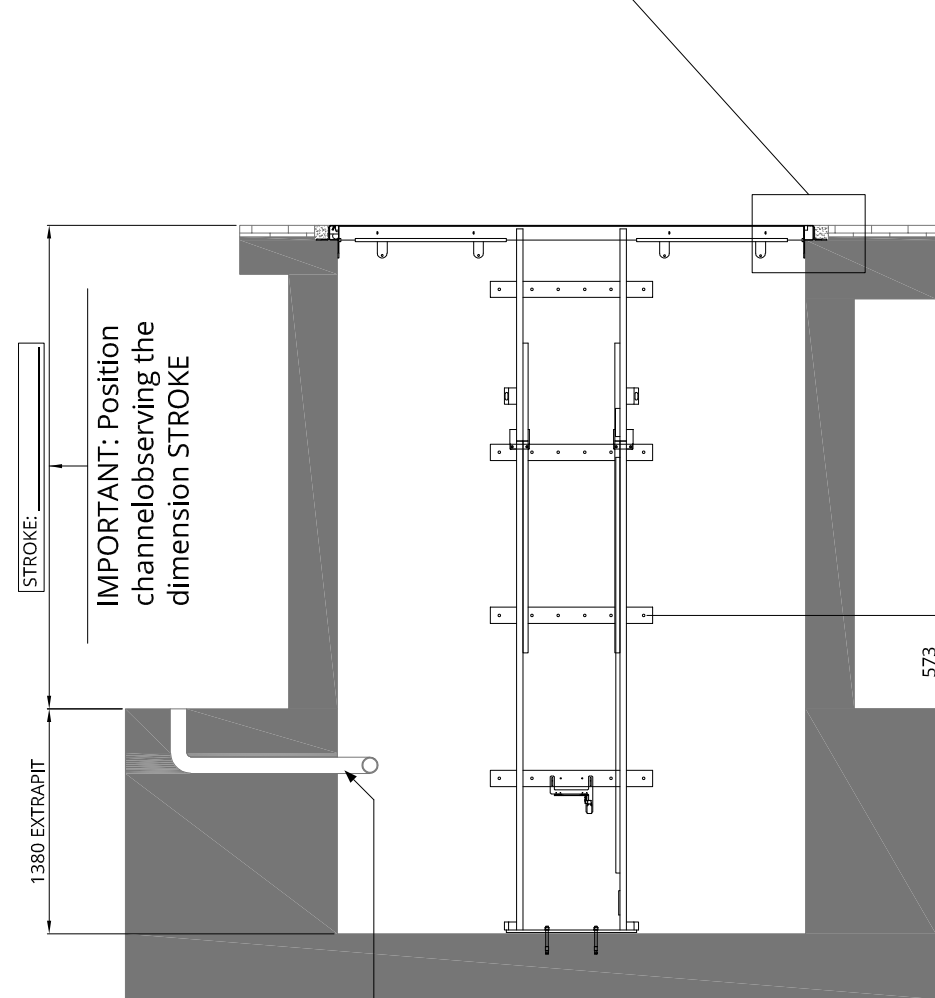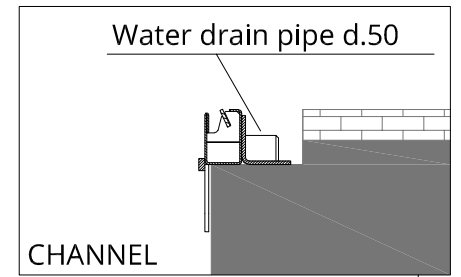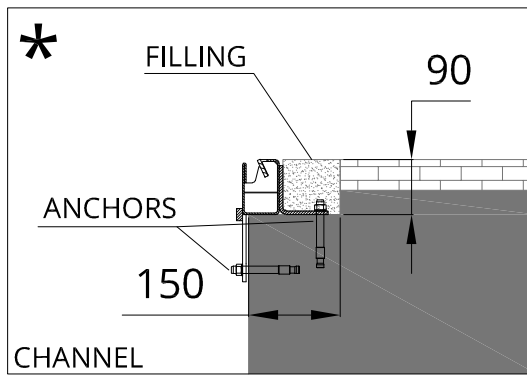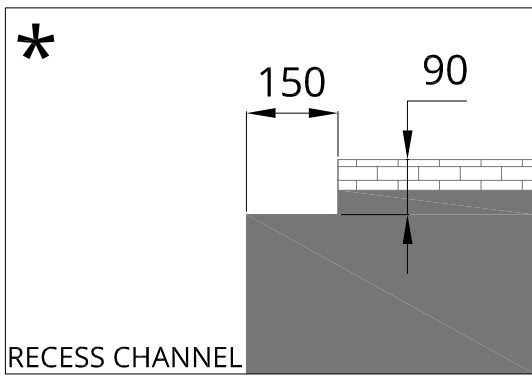


IMPORTANT: Position guides observing the dimension indicated by the channel and check 573 from the downstairs level

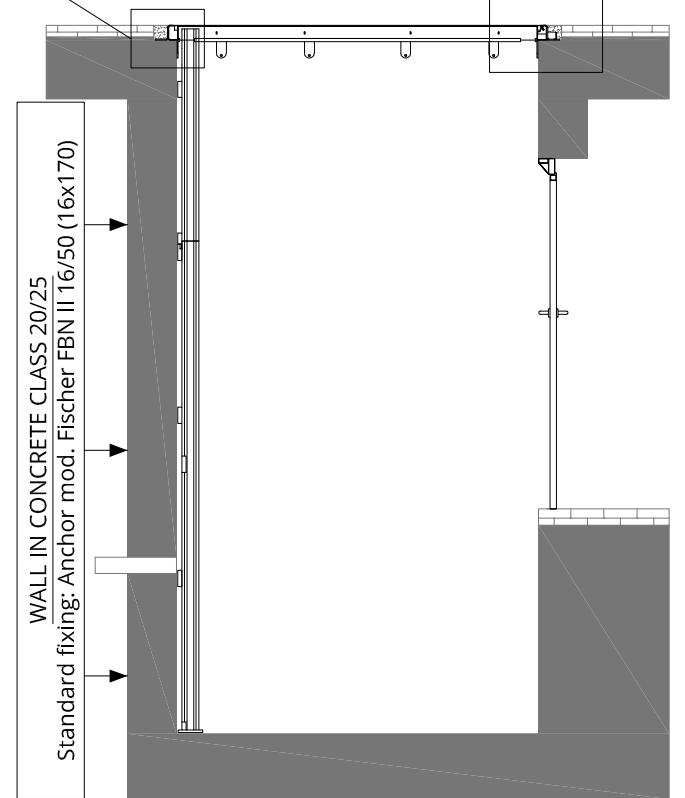


CONCRETE CLASS 20/25

PREPARE CORRUGATED TUBE Ø10cm TO THE TECHNICAL AREA

Water drain pipe d.50

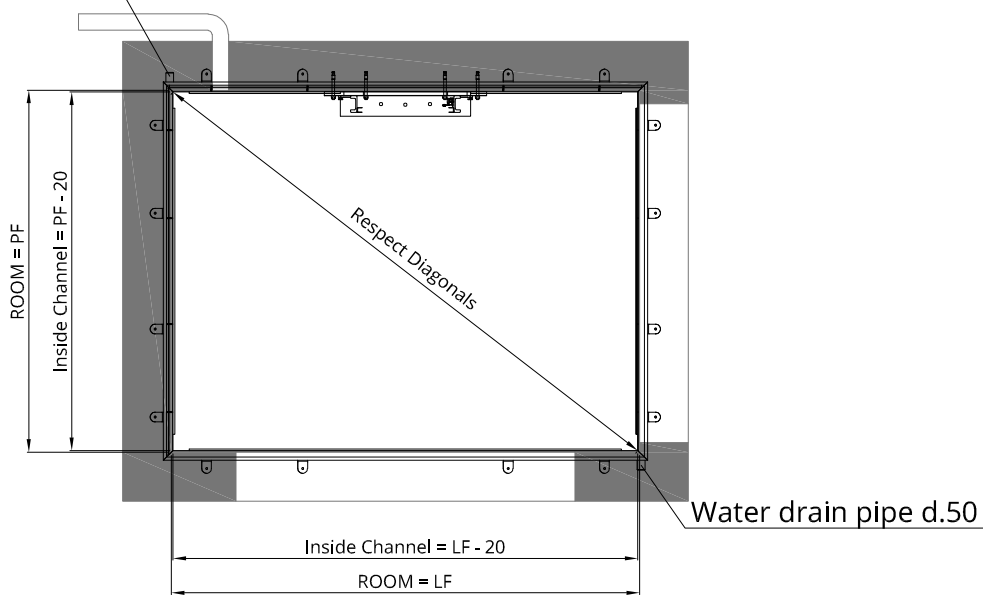

MARK THE ENTRANCES AND THE HEIGHT OF FLOOR

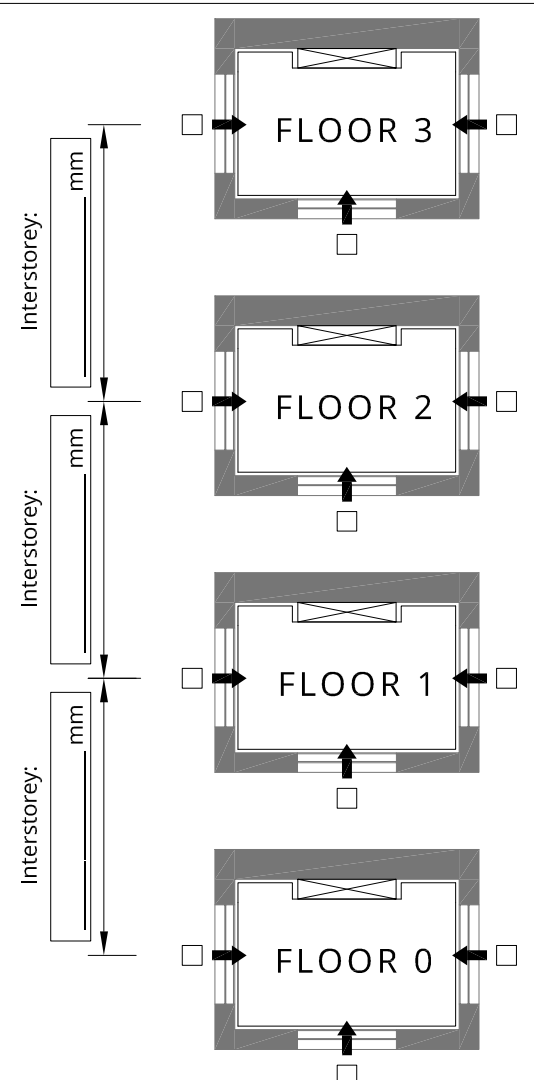

Motor	Tension-functioning	Starter	Suggested switch*	Rated current	Current starter
3kW	220 V - 3ph	Direct	3x16A id=0,3A	10	35
	380 V - 3ph	Direct	4x16A id=0,3A	5	22
4kW	220 V - 3ph	Direct	3x20A id=0,3A	16	50
	380 V - 3ph	Direct	4x16A id=0,3A	8	25
5,5kW	220 V - 3ph	Direct	4x25A id=0,3A	22	60
	380 V - 3ph	Direct	4x16A id=0,3A	11	35


MODEL: UP5RT - 500Kg UP10RT - 1000Kg

Date: _____ Signature for approval: _____




MISURE IN mm

FLATBED DIMENSION (grey area)

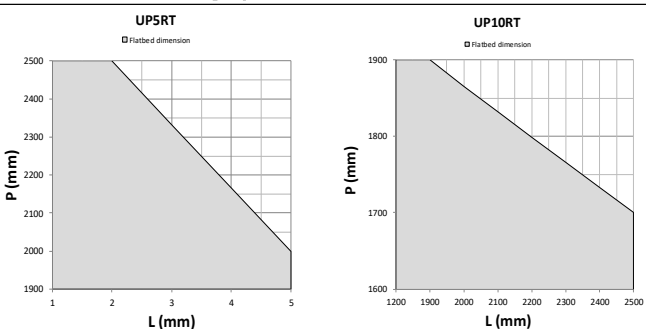

Force on the wall, Fx function of depth flatbed

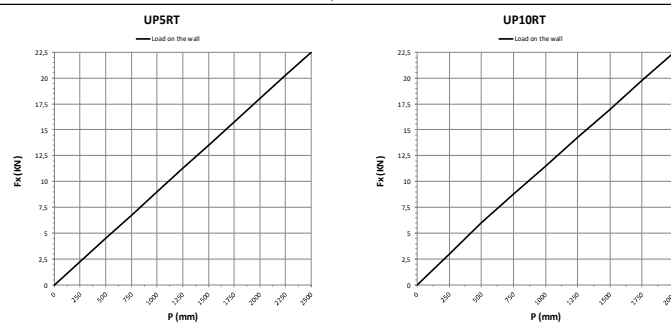

directlifts 1300 240 298 | info@directlifts.com.au | www.directlifts.com.au

Q.TA	DESCRIZIONE:	Cliente:
	MODEL: UP5-10RT SPB	Uso: _____ Data: 09/09/19
	STROKE MAX: 12000mm	Disegno n°:
	PIT DETAILS	TAV-UP5-10RT-PIT
		Sostituto dat.:
		Sostitutore it.: